



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

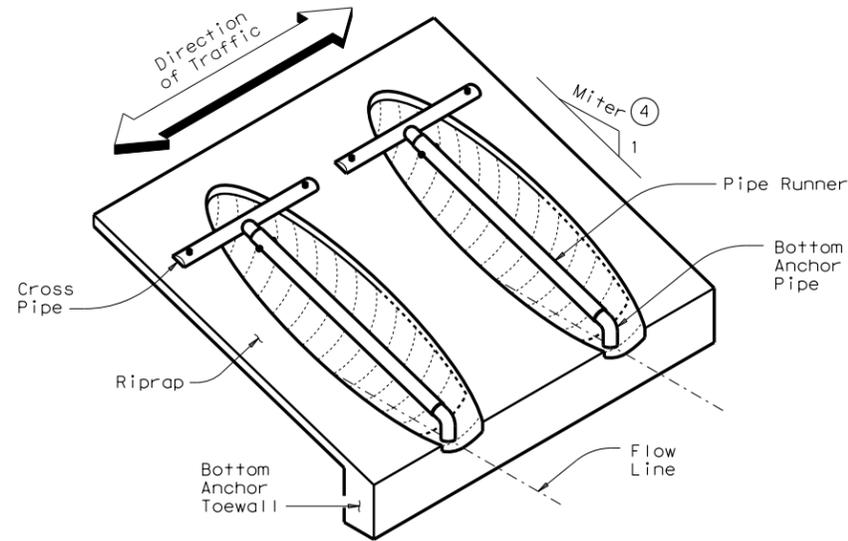

**ISOMETRIC VIEW OF TYPICAL INSTALLATION**


(Showing installation with no skew.)

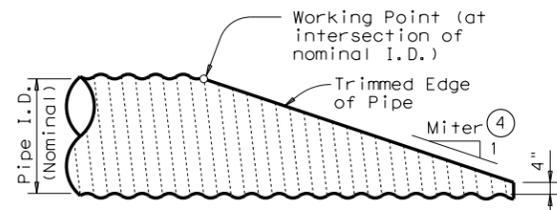

NOTE: All Pipe Runners, calculations, and dimensions are based on the pipe culverts mitered as shown in this detail. Alternate styles of mitered ends will require that appropriate adjustments be made to the values presented on this standard.

**SIDE ELEVATION OF TYPICAL PIPE CULVERT MITER**

(Showing Corrugated Metal Pipe Culvert. Details of Concrete Pipe Culvert are similar.)

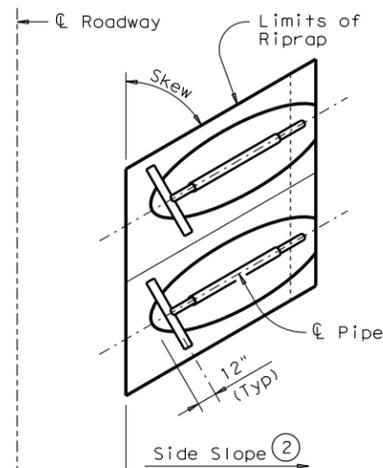

**PLAN OF SKEWED INSTALLATION**

① ③

**CROSS PIPE LENGTHS, PIPE RUNNER LENGTHS, & REQUIRED PIPE SIZES**

**CORRUGATED METAL PIPE CULVERTS**

Design	Pipe Culvert Span	Pipe Culvert Rise	Pipe Culvert Spa ~ G	Cross Pipe Length	Pipe Runner Length												
					3:1 Side Slope				4:1 Side Slope				6:1 Side Slope				
					0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	
1	17"	13"	1'-0"	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
2	21"	15"	1'-2"	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3	28"	20"	1'-5"	3'-9"	N/A	N/A	3'-5"	4'-7"	N/A	N/A	4'-11"	6'-5"	N/A	N/A	7'-11"	10'-2"	
4	35"	24"	1'-8"	4'-4"	3'-10"	4'-0"	4'-7"	6'-0"	5'-5"	5'-8"	6'-6"	8'-4"	8'-8"	9'-1"	10'-3"	12'-11"	
5	42"	29"	1'-11"	4'-11"	5'-1"	5'-4"	6'-1"	7'-10"	7'-2"	7'-5"	8'-6"	10'-9"	11'-2"	11'-8"	13'-2"	16'-6"	
6	49"	33"	2'-2"	5'-6"	6'-2"	6'-5"	7'-4"	N/A	8'-6"	8'-10"	10'-0"	N/A	13'-3"	13'-9"	15'-6"	N/A	
7	57"	38"	2'-5"	6'-2"	7'-6"	7'-9"	N/A	N/A	10'-2"	10'-7"	N/A	N/A	15'-9"	16'-4"	N/A	N/A	

**CONCRETE PIPE CULVERTS**

Design	Pipe Culvert Span	Pipe Culvert Rise	Pipe Culvert Spa ~ G	Cross Pipe Length	Pipe Runner Length												
					3:1 Side Slope				4:1 Side Slope				6:1 Side Slope				
					0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	
1	22"	13 1/2"	1'-0"	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
2	26"	15 1/2"	1'-2"	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3	28 1/2"	18"	1'-5"	3'-9 1/2"	N/A	N/A	2'-10"	3'-10"	N/A	N/A	4'-2"	5'-5"	N/A	N/A	6'-9"	8'-9"	
4	36 1/4"	22 1/2"	1'-8"	4'-5 1/4"	3'-5"	3'-7"	4'-2"	5'-6"	4'-11"	5'-1"	5'-11"	7'-7"	7'-11"	8'-3"	9'-5"	11'-11"	
5	43 3/4"	26 5/8"	1'-11"	5'-0 3/4"	4'-6"	4'-8"	5'-5"	6'-11"	6'-4"	6'-7"	7'-6"	9'-7"	10'-0"	10'-5"	11'-9"	14'-10"	
6	51 1/8"	31 3/8"	2'-2"	5'-8"	5'-9"	6'-0"	6'-10"	N/A	7'-11"	8'-3"	9'-4"	N/A	12'-4"	12'-10"	14'-6"	N/A	
7	58 1/2"	36"	2'-5"	6'-3 1/2"	6'-11"	7'-3"	N/A	N/A	9'-6"	9'-11"	N/A	N/A	14'-9"	15'-4"	N/A	N/A	

**TYPICAL PIPE CULVERT MITERS (4)**

Side Slope	0° Skew	15° Skew	30° Skew	45° Skew
3:1	3:1	3.106:1	3.464:1	4.243:1
4:1	4:1	4.141:1	4.619:1	5.657:1
6:1	6:1	6.212:1	6.928:1	8.485:1

**STANDARD PIPE SIZES & MAX PIPE RUNNER LENGTHS (1)**

Pipe Size	Pipe O.D.	Pipe I.D.	Max Pipe Runner Length
2" STD	2.375"	2.067"	N/A
3" STD	3.500"	3.068"	10'-0"
4" STD	4.500"	4.026"	19'-8"
5" STD	5.563"	5.047"	34'-2"

**CONDITIONS WHERE PIPE RUNNERS ARE NOT REQUIRED (3)**

Design	Single Pipe Culvert	Multiple Pipe Culverts
1 & 2	Skews thru 45°	Skews thru 45°
3	Skews thru 30°	Skews thru 15°
4	Normal (No Skew)	Always required
5 thru 7	Always required	Always required

**GENERAL NOTES:**

Pipe Runners are designed for a traversing load of 1,800 pounds at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.

The Safety End Treatments shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the Pipe Runners.

Riprap and all necessary inverts shall be Concrete Riprap conforming to the requirements of Item 432, "Riprap".

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.

Payment for riprap and toewall is included in the Price Bid for each Safety End Treatment.

Pipe Runners, Cross Pipes, and Anchor Pipes shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Bolts and nuts shall conform to ASTM A307.

All steel components, except concrete reinforcing, shall be galvanized after fabrication. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

- Size of Pipe Runner shall be as shown in the tables. Cross Pipe shall be the same size as the Pipe Runner. Cross Pipe Stub Out and Bottom Anchor Pipe shall be the next smaller size pipe as shown in the STANDARD PIPE SIZES table.
- Recommended values of slope are 3:1, 4:1, & 6:1. All quantities, calculations, and dimensions shown herein are based on these recommended values. Slope of 3:1 or flatter is required for vehicle safety.
- This standard allows for the placement of only one pipe runner across each culvert pipe opening. In order to limit the clear opening to be traversed by an errant vehicle, the following conditions must be met:
  - For Design 1 through 5 culvert pipe sizes, the skew must not exceed 45°.
  - For Design 6 culvert pipes, the skew must not exceed 30°.
  - For Design 7 culvert pipes, the skew must not exceed 15°.

If the above conditions cannot be met, the designer should consider using a safety end treatment with flared wings. For further information, refer to the TxDOT "Roadway Design Manual".
- Miter = Slope of Mitered Pipe Culvert End


SHEET 1 OF 3

		<b>Bridge Division Standard</b>	
<b>SAFETY END TREATMENT</b> FOR DESIGN 1 TO 7 ARCH PIPE CULVERTS TYPE II ~ CROSS DRAINAGE			
<b>SETP-CD-A</b>			
FILE: setpcae.dgn	DN: GAF	CK: CAT	DW: JRP
©TxDOT February 2010	CONT	SECT	JOB
REVISIONS			
11-10: Add note for synthetic fibers.	DIST	COUNTY	SHEET NO.

DATE: FILE:


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:

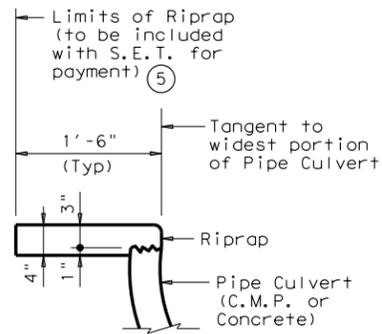

SHOWING TYPICAL PIPE CULVERT & RIPRAP

**SECTION A-A**

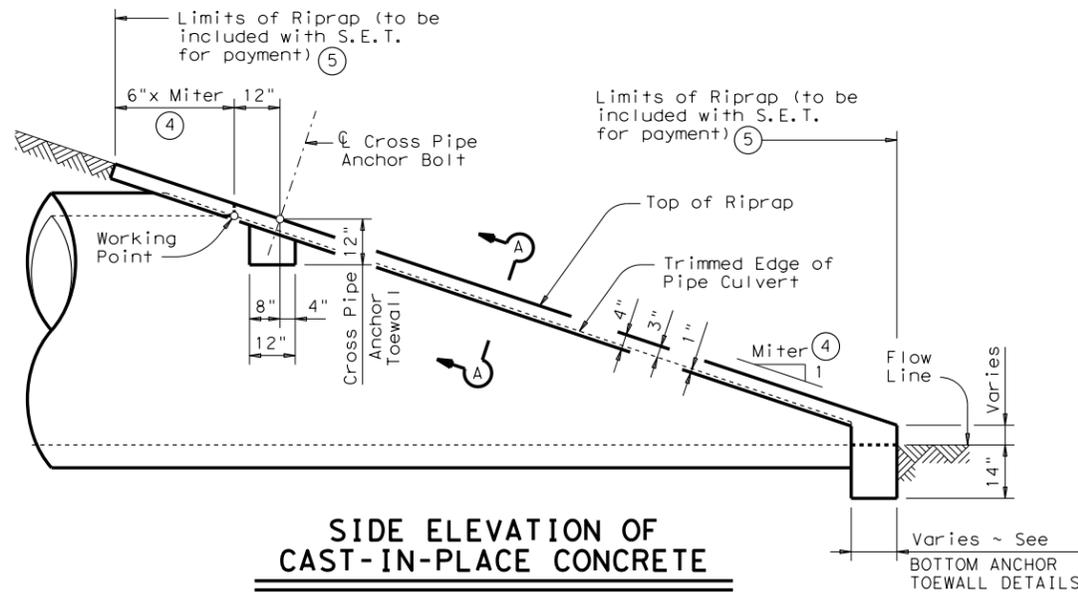

**SIDE ELEVATION OF CAST-IN-PLACE CONCRETE**

(Showing Concrete Pipe Culvert. Details of Corrugated Metal Pipe Culvert are similar. Pipe Runners not shown for clarity)

**ESTIMATED CONCRETE RIPRAP QUANTITIES (CY) 6**  
**BOTH CORRUGATED METAL PIPE CULVERTS AND CONCRETE PIPE CULVERTS**

Design	3:1 Side Slope				4:1 Side Slope				6:1 Side Slope			
	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew	0° Skew	15° Skew	30° Skew	45° Skew
1	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.8	0.9
2	0.5	0.5	0.6	0.6	0.6	0.6	0.6	0.7	0.7	0.8	0.8	1.0
3	0.6	0.6	0.7	0.8	0.7	0.7	0.8	0.9	0.9	1.0	1.0	1.2
4	0.7	0.7	0.8	0.9	0.8	0.9	0.9	1.0	1.1	1.1	1.2	1.4
5	0.8	0.8	0.9	1.0	1.0	1.0	1.1	1.2	1.3	1.3	1.4	1.7
6	0.9	1.0	1.0	N/A	1.1	1.1	1.2	N/A	1.4	1.5	1.6	N/A
7	1.0	1.1	N/A	N/A	1.3	1.3	N/A	N/A	1.7	1.7	N/A	N/A

- ④ Miter = Slope of Mitered Pipe Culvert End
- ⑤ Riprap placed beyond the limits shown will be paid as Concrete Riprap in accordance with Item 432, "Riprap".
- ⑥ Quantities shown are for one end of one Pipe Culvert. For multiple Pipe Culverts, quantities will need to be adjusted. Riprap quantities are for Contractor's information only.




**SAFETY END TREATMENT**  
FOR DESIGN 1 TO 7  
ARCH PIPE CULVERTS  
TYPE II ~ CROSS DRAINAGE

**SETP-CD-A**


FILE: setpcase.dgn	DN: GAF	CK: CAT	DW: JRP	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS				
11-10: Add note for synthetic fibers.	DIST	COUNTY	SHEET NO.	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

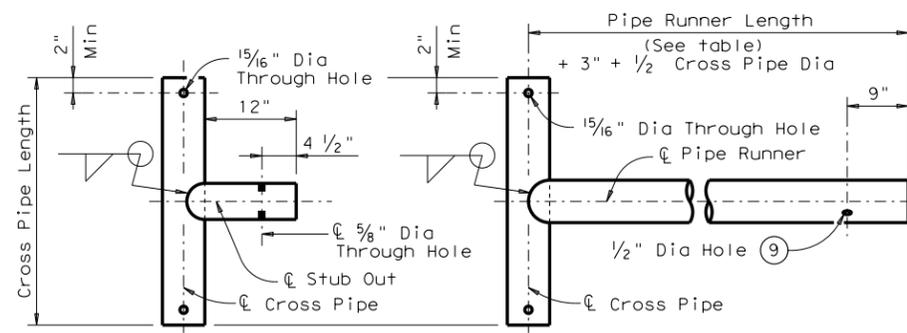


**CROSS PIPE AND CONNECTIONS DETAILS**

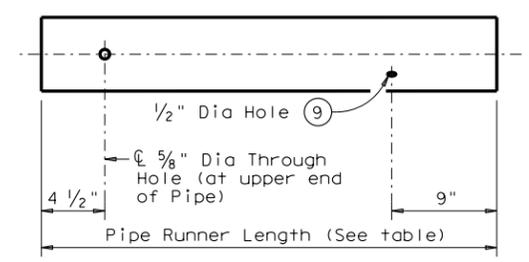


NOTE: The separate Pipe Runner shown is required when Cross Pipe Connection Option A1 is used.

**PIPE RUNNER DETAILS**

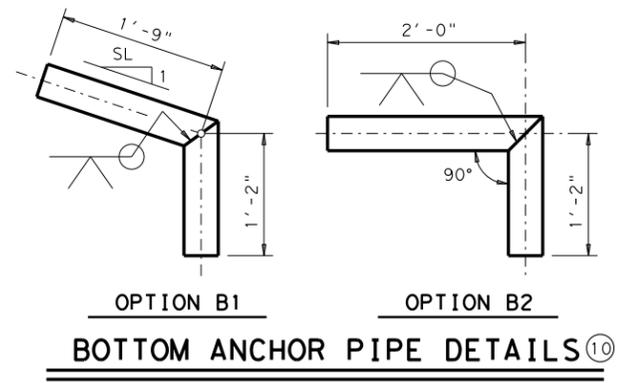


**BOTTOM ANCHOR PIPE DETAILS**

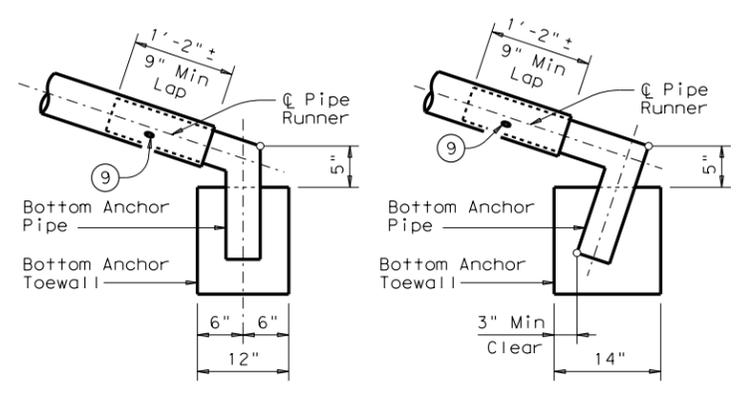


**BOTTOM ANCHOR TOEWALL DETAILS**

(Culvert & Riprap not shown for clarity)

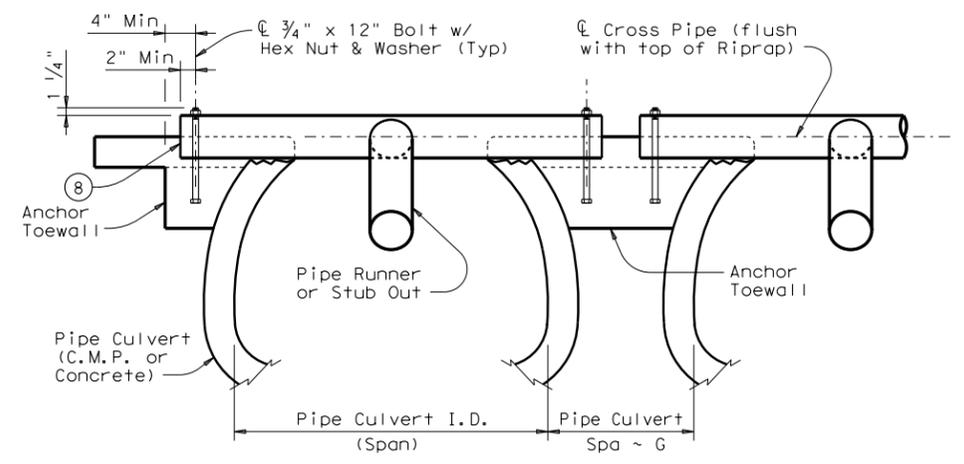

**SECTION A-A**

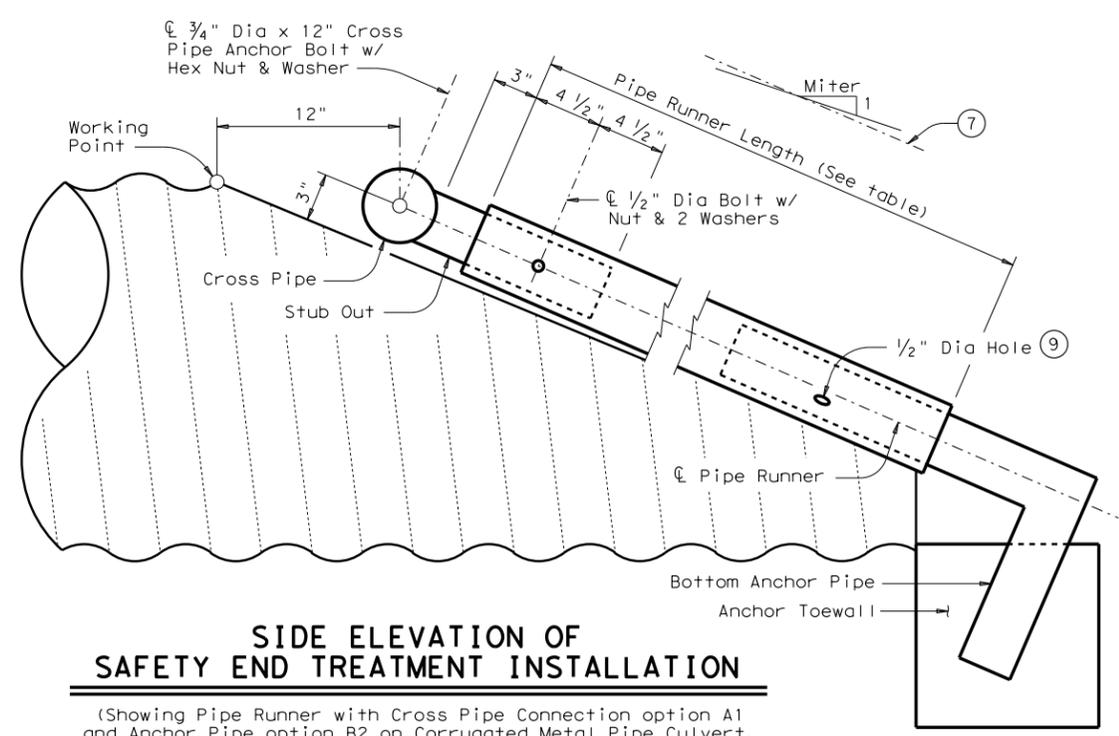

**SIDE ELEVATION OF SAFETY END TREATMENT INSTALLATION**

(Showing Pipe Runner with Cross Pipe Connection option A1 and Anchor Pipe option B2 on Corrugated Metal Pipe Culvert. Concrete Pipe Culvert details are similar. Riprap not shown for clarity)

- ⑦ Note that actual slope of Pipe Runner may vary slightly from Side Slope of Riprap and trimmed Culvert Pipe edge.
- ⑧ Care shall be taken to ensure that Riprap concrete does not flow into the Cross Pipe so as to permit disassembly of the bolted connection to allow cleanout access.
- ⑨ After installation, the 1/2 inch hole shall be inspected to ensure that the lap of the Pipe Runner with the Bottom Anchor Pipe is adequate.
- ⑩ At fabricator's option, a heat bend to a smooth 5 inch radius or a manufactured elbow (of the same material as the Runner) may be substituted for the mitered and welded joint in the Bottom Anchor Pipe.

**SAFETY END TREATMENT FOR DESIGN 1 TO 7 ARCH PIPE CULVERTS TYPE II ~ CROSS DRAINAGE**

**SETP-CD-A**

FILE: setpcase.dgn	DN: GAF	CK: CAT	DW: JRP	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS				
11-10: Add note for synthetic fibers.	DIST	COUNTY	SHEET NO.	