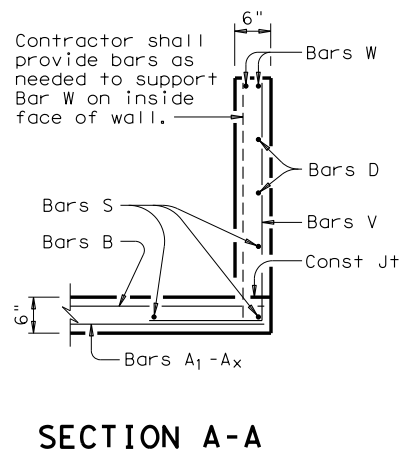
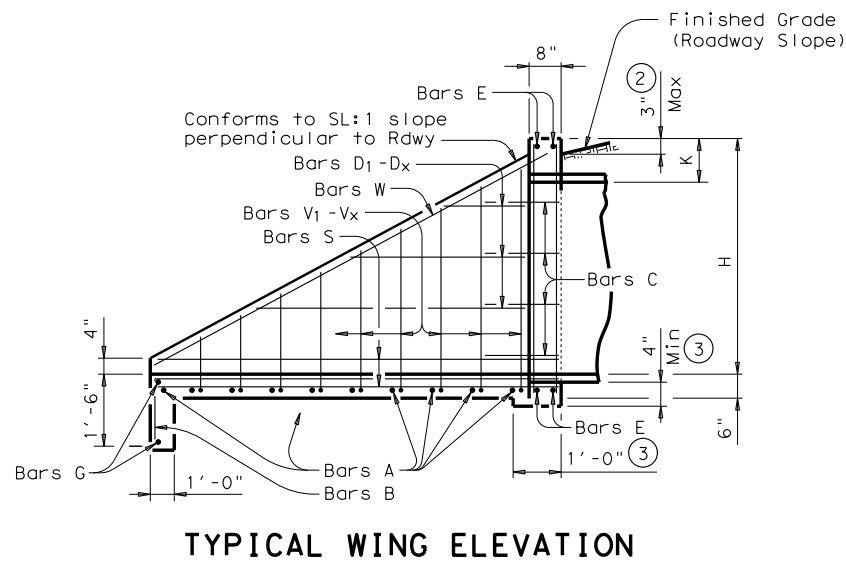
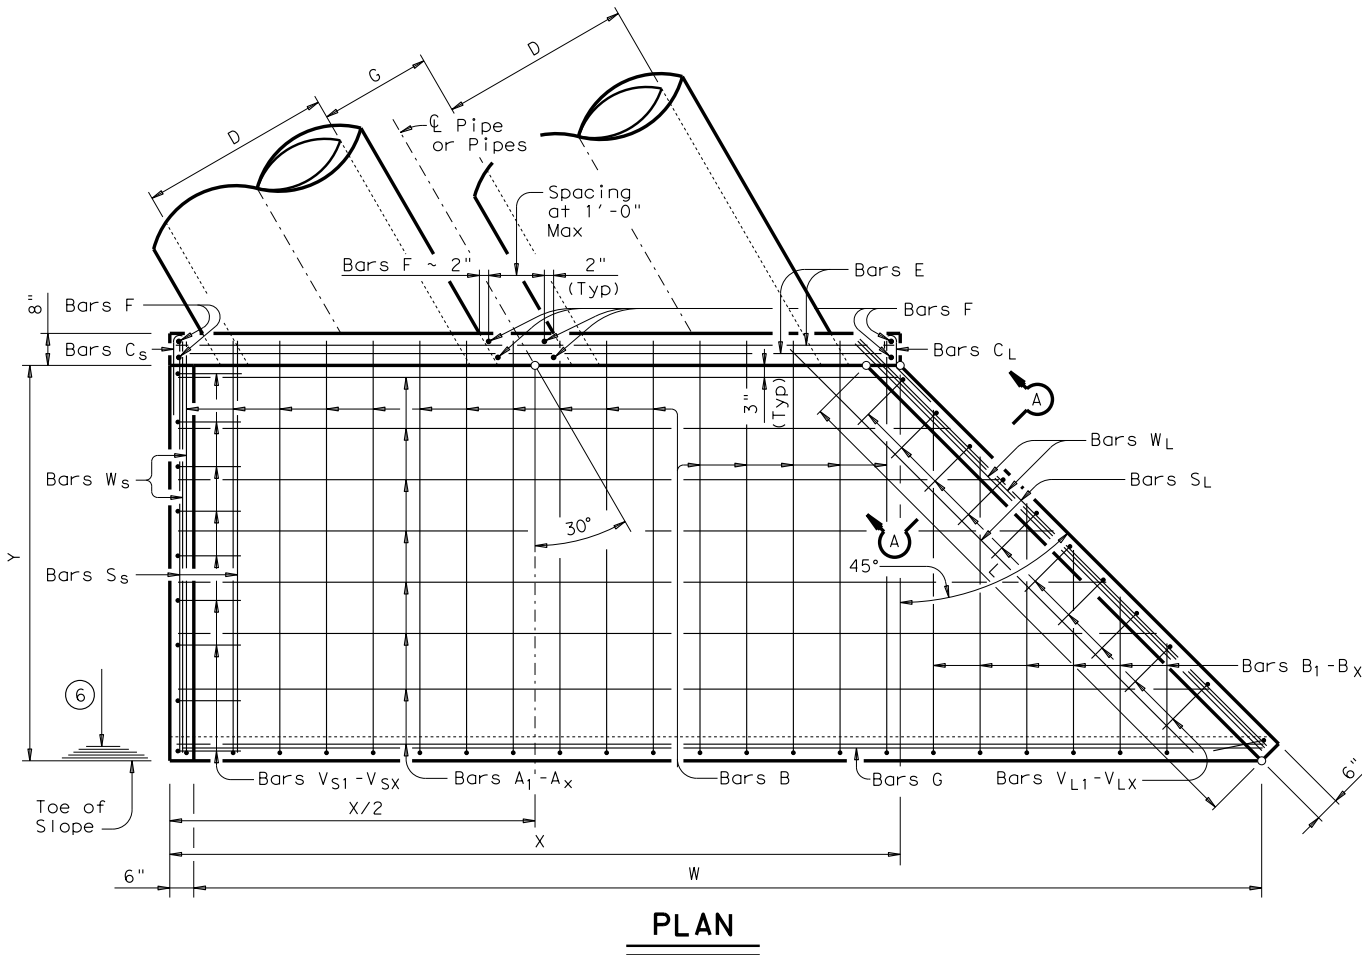
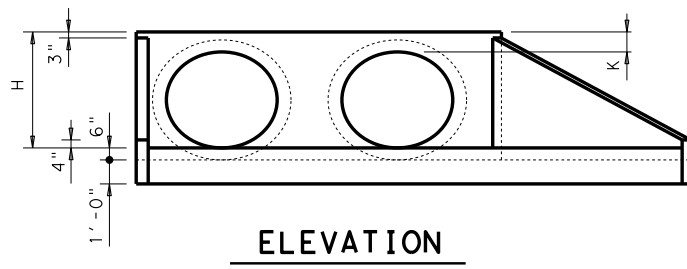
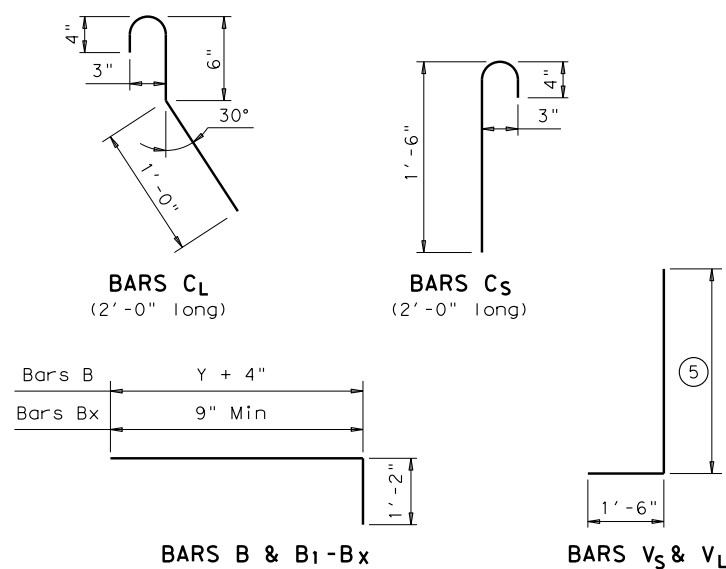


**TABLE OF VARIABLE DIMENSIONS AND QUANTITIES FOR ONE HEADWALL** ④

SLOPE	DIA OF PIPE, D	Values for one pipe				Values to be added for each add'l pipe				
		W	X	Y	L	Reinf (Lbs)	Conc (CY)	X and W	Reinf (Lbs)	Conc (CY)
3:1	24"	10'-7 1/2"	4'-7"	7'-3"	10'-3"	227	2.3	4'-1 3/4"	65	0.9
	27"	11'-8 1/2"	4'-11"	8'-0"	11'-3 3/4"	255	2.7	4'-6 1/4"	75	1.0
	30"	12'-9 1/2"	5'-3"	8'-9"	12'-4 1/2"	298	3.1	5'-0"	86	1.2
	33"	13'-10 3/4"	5'-7"	9'-6"	13'-5 1/4"	322	3.5	5'-4 3/4"	94	1.4
	36"	14'-11 3/4"	5'-11 1/4"	10'-3"	14'-6"	355	4.0	5'-10 1/2"	108	1.6
	42"	17'-1 3/4"	6'-7 1/4"	11'-9"	16'-7 1/2"	441	5.0	6'-8 3/4"	133	2.1
	48"	20'-0 3/4"	7'-3 1/4"	14'-0"	19'-9 1/2"	542	6.6	7'-7 1/4"	176	2.8
	54"	22'-3"	7'-11 1/2"	15'-6"	21'-11"	626	7.9	8'-8"	211	3.5
	60"	24'-5"	8'-7 1/2"	17'-0"	24'-0 1/2"	725	9.4	9'-6 1/4"	246	4.1
	66"	26'-7"	9'-3 1/2"	18'-6"	26'-2"	821	10.9	10'-1 1/4"	274	4.6
4:1	24"	13'-0 1/2"	4'-7"	9'-8"	13'-8"	301	3.1	4'-1 3/4"	75	1.1
	27"	14'-4 1/2"	4'-11"	10'-8"	15'-1"	339	3.7	4'-6 1/4"	87	1.3
	30"	15'-8 1/2"	5'-3"	11'-8"	16'-6"	394	4.2	5'-0"	99	1.5
	33"	17'-0 3/4"	5'-7"	12'-8"	17'-11"	432	4.9	5'-4 3/4"	112	1.7
	36"	18'-4 3/4"	5'-11 1/4"	13'-8"	19'-4"	479	5.5	5'-10 1/2"	128	2.0
	42"	21'-0 3/4"	6'-7 1/4"	15'-8"	22'-1 3/4"	587	7.0	6'-8 3/4"	158	2.6
	48"	24'-8 3/4"	7'-3 1/4"	18'-8"	26'-4 3/4"	738	9.4	7'-7 1/4"	211	3.4
	54"	27'-5"	7'-11 1/2"	20'-8"	29'-2 3/4"	871	11.3	8'-8"	257	4.3
	60"	30'-1"	8'-7 1/2"	22'-8"	32'-0 3/4"	999	13.3	9'-6 1/4"	297	5.1
	66"	32'-9"	9'-3 1/2"	24'-8"	34'-10 1/2"	1139	15.6	10'-1 1/4"	340	5.8
6:1	24"	17'-10 1/2"	4'-7"	14'-6"	20'-6"	450	5.1	4'-1 3/4"	91	1.5
	27"	19'-8 1/2"	4'-11"	16'-0"	22'-7 1/2"	519	6.0	4'-6 1/4"	108	1.7
	30"	21'-6 1/2"	5'-3"	17'-6"	24'-9"	595	7.1	5'-0"	124	2.0
	33"	23'-4 3/4"	5'-7"	19'-0"	26'-10 1/2"	674	8.2	5'-4 3/4"	143	2.4
	36"	25'-2 3/4"	5'-11 1/4"	20'-6"	29'-0"	737	9.3	5'-10 1/2"	162	2.8
	42"	28'-10 3/4"	6'-7 1/4"	23'-6"	33'-2 3/4"	920	11.9	6'-8 3/4"	202	3.6
	48"	34'-0 3/4"	7'-3 1/4"	28'-0"	39'-7 1/4"	1189	16.2	7'-7 1/4"	274	4.7

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

- Quantities shown are for concrete pipe and will increase slightly for Metal Pipe installation.
- For vehicle safety, curbs shall project no more than 3" above finished grade. Curb heights shall be reduced, if necessary, to meet these requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Provide a 1'-0" footing as shown where required to maintain 4" minimum cover for pipes.
- Quantities shown are for one structure end. (One headwall)
- Min Length =  $6" + 3" \times \left(\frac{12 \times H - 7}{12 \times L}\right)$   
 Max Length =  $12 \times H - 3" \times \left(\frac{12 \times H - 7}{12 \times L}\right) - 1"$
- Lengths of wings based on SL:1 Slope along this line.



**TABLE OF REINFORCING STEEL** ④

Bar	Size	Spa	No.
A	# 4	1'-0"	~
B	# 3	1'-6"	~
CL	# 4	1'-0"	~
CS	# 4	1'-0"	~
D	# 3	1'-0"	~
E	# 5	~	4
F	# 5	~	~
G	# 3	~	2
SL	# 4	~	3
SS	# 4	~	3
V	# 4	1'-0"	~
WL	# 5	~	2
WS	# 5	~	2

**TABLE OF CONSTANT DIMENSIONS**

DIA OF PIPE, D	G	K	H
24"	1'-7"	1'-0"	3'-0"
27"	1'-8"	1'-0"	3'-3"
30"	1'-10"	1'-0"	3'-6"
33"	1'-11"	1'-0"	3'-9"
36"	2'-1"	1'-0"	4'-0"
42"	2'-4"	1'-0"	4'-6"
48"	2'-7"	1'-3"	5'-3"
54"	3'-0"	1'-3"	5'-9"
60"	3'-3"	1'-3"	6'-3"
66"	3'-3"	1'-3"	6'-9"
72"	3'-4"	1'-3"	7'-3"

**GENERAL NOTES:**

Designed according to AASHTO LRFD Specifications.

The Safety End Treatment shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the pipe runners.

The Safety Pipe Runners are designed for a traversing load of 1,800 pounds at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.

Reinforcing steel shall be placed with the center of the outside layer of bars 2" from the surface of the concrete.

All reinforcing steel shall be Grade 60.

All concrete shall be Class "C" and shall have a minimum compressive strength of 3600 psi.

All bolts, nuts, washers, brackets, angles and pipe runners are considered parts of the Safety End Treatment for payment.

Pipe Runners shall conform to the requirements of ASTM A53 (Type E or S, Grade B), ASTM A500 (Grade B), or API 5LX52.

Bolts and nuts shall conform to ASTM A307.

Steel plates shall conform to ASTM A36. All steel components, except reinforcing, shall be galvanized. Galvanizing damaged during transport or construction shall be repaired in accordance with the specifications.

Bridge Division Standard


**SAFETY END TREATMENT WITH FLARED WINGS**  
 FOR 30° SKEW PIPE CULVERTS  
 TYPE I ~ CROSS DRAINAGE

**SETP-FW-30**

FILE: stpf30se.dgn	DN: GAF	CK: CAT	DW: BWH	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST	COUNTY	SHEET NO.	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

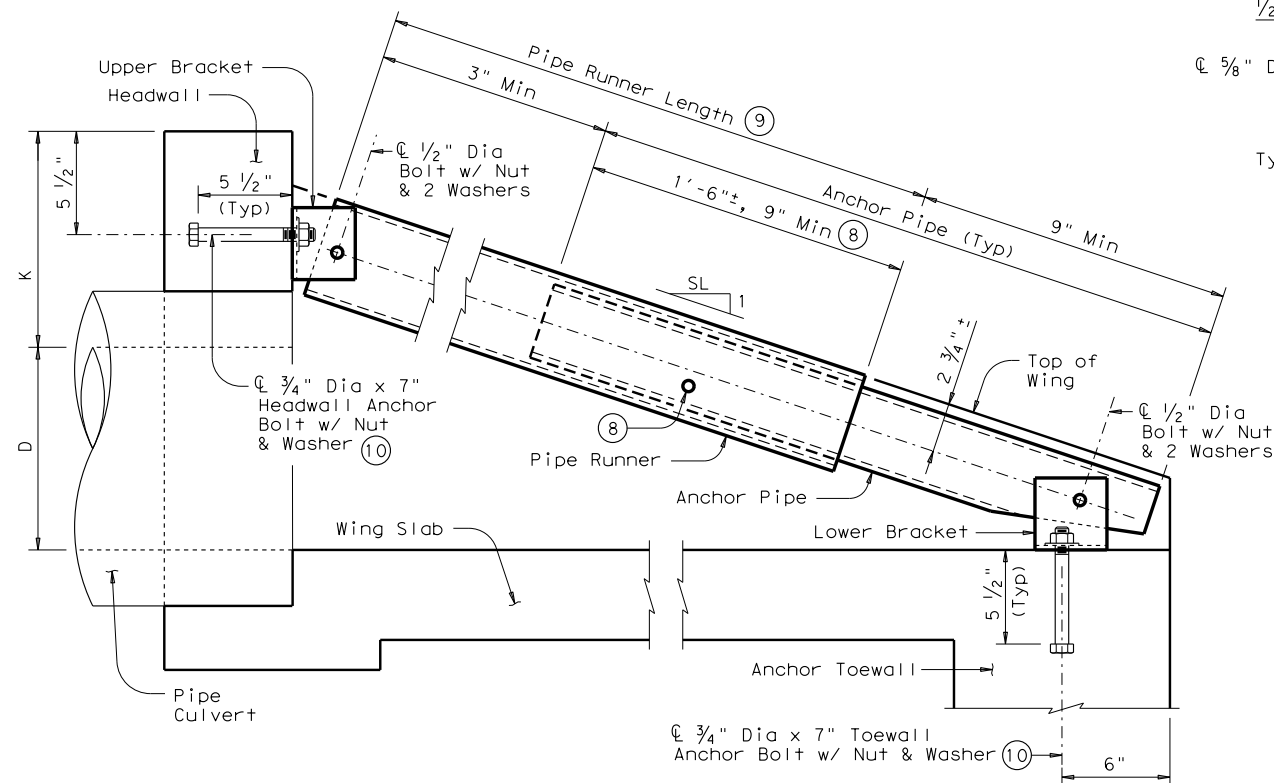

**SECTION B-B**


(Showing Headwall Pipe Runner. Except for upper bracket, Wingwall Pipe Runners are similar.)

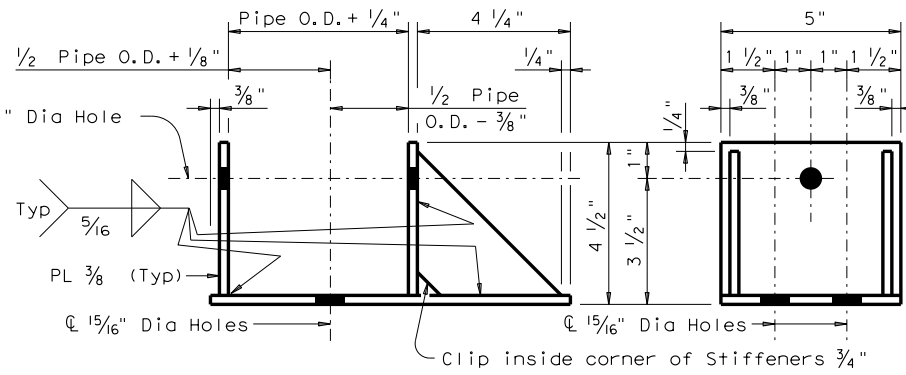

**ELEVATION**

**SIDE VIEW**

3/4" Anchor Bolt shall be installed in hole nearest to the headwall. Other bolt hole is intended for use on the opposite hand wingwall.

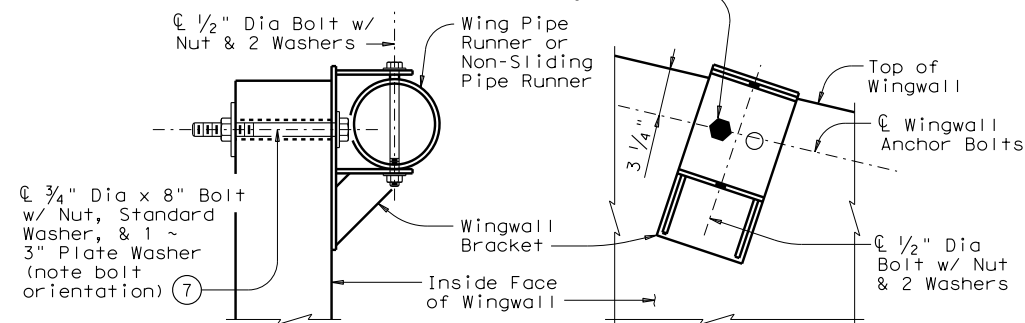


**SECTION C-C**

**ELEVATION**

(Showing installed bracket.) (Showing installed bracket normal to Wall. Pipe not shown for clarity.)

NOTE: Wingwall Bracket shall match the Upper Bracket size.

**WINGWALL BRACKET DETAILS**

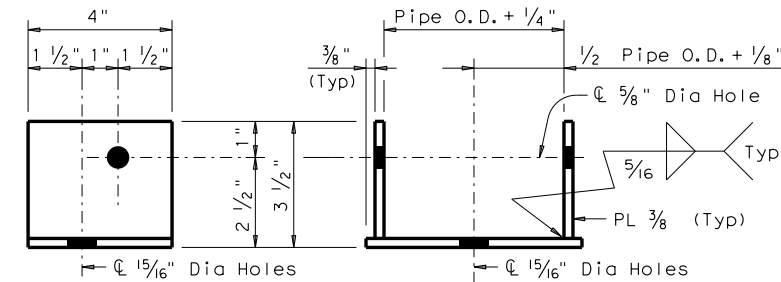


**SIDE VIEW**

**ELEVATION**

NOTE: Upper and Lower Brackets shall, except for the Brackets used with Non-Sliding Pipe Runners, match the required pipe diameters as shown in the table.


**UPPER & LOWER BRACKET DETAILS**

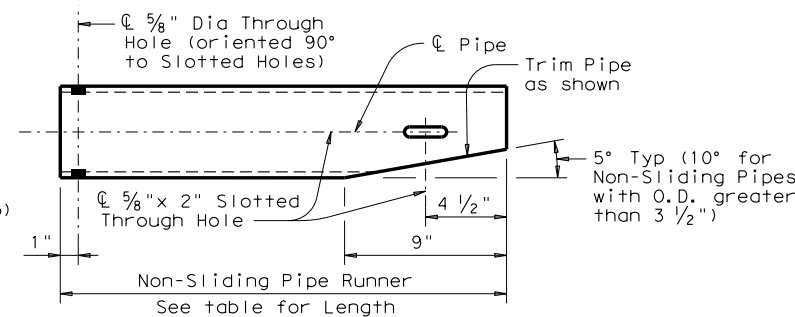

Note: Pipe size shall be same as required for headwall pipe runner. Adjust the corresponding Lower Bracket accordingly.


**NON-SLIDING PIPE RUNNER DETAILS ⑨**

- ⑦ At Contractor's option, 7/8" diameter hole may be formed or cored drilled. Percussion drilling is not permitted. Adjust placement of reinforcing steel as necessary to avoid bolt holes.
- ⑧ After installation of the Pipe Runner, the 1/2" inspection hole shall be utilized to ensure that the lap of the Anchor Pipe with the Pipe Runner is adequate.
- ⑨ Non-Sliding Pipe Runners are used for those installations that would require Pipe Runner lengths of 1'-9" or less. The Non-Sliding Pipe Runner, when required, replaces the outermost Pipe Runner and Anchor Pipe. See table on Sheet 3 of 3 to determine if the Non-Sliding Pipe Runner is required.
- ⑩ At Contractor's option, an epoxy anchorage system may be used. Anchorage system chosen must be able to achieve an ultimate tensile resistance of 20 kips. Anchor diameter shall be 3/4". The Contractor must provide evidence to the Engineer that this can be achieved. Evidence of adequate tensile resistance can be based on the manufacturer's published values of ultimate tensile strength (anchor spacing and edge distance must be accounted for). Anchor installation, including hole size, drilling, and clean-out, must be in accordance with the manufacturer's recommendations.

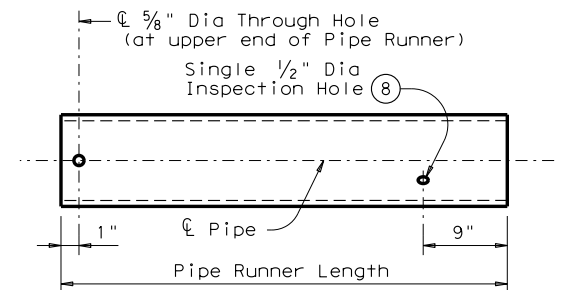


Note: Pipe diameter required for Headwall pipe runner shall also be used for wingwall pipe runner.

**PIPE RUNNER DETAILS**

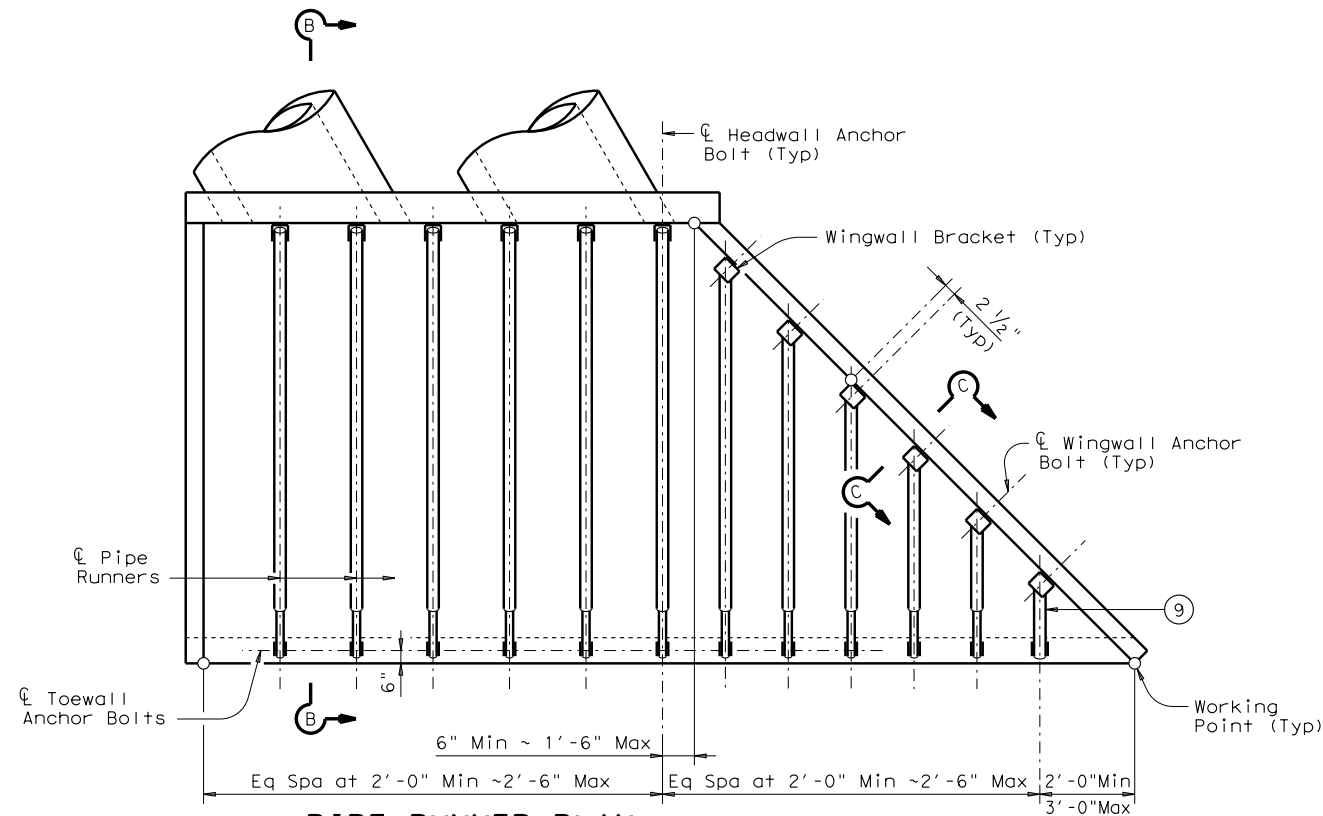

**PIPE RUNNER PLAN**

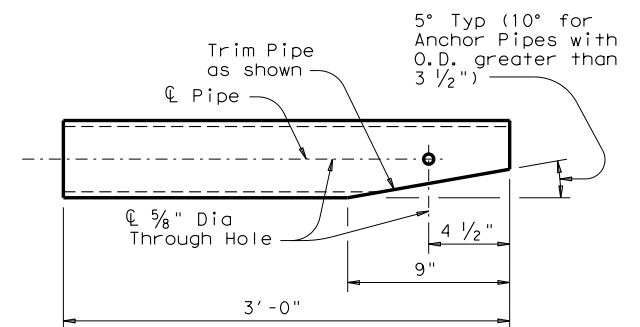

**ANCHOR PIPE DETAILS**

SHEET 2 OF 3

		<b>Bridge Division Standard</b>	
<b>SAFETY END TREATMENT WITH FLARED WINGS</b>			
<b>FOR 30° SKEW PIPE CULVERTS TYPE I ~ CROSS DRAINAGE</b>			
<b>SETP-FW-30</b>			
FILE: stpf30se.dgn	DN: GAF	CK: CAT	DW: TxDOT
©TxDOT February 2010	CONT	SECT	JOB
REVISIONS			HIGHWAY
	DIST	COUNTY	SHEET NO.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

Pipe Culvert Dia (In)	Number of Pipe Culverts	No. of L2 Spaces	L2 Overall Dimension (Ft-In)	Number of Headwall Pipes	Side Slope	Pipe Culvert Dia (In)	L1 (Ft-In)	P1 (Ft-In)	Number of Spaces in L3	L3 Overall Dimension (Ft-In)	P2 (Ft-In)	Number of Spaces in L4	L4 Overall Dimension (Ft-In)	Headwall Pipe Runner Length (Ft-In)	No. of Wing Pipes (12)	Longest Wingwall Pipe Runner Length (Ft-In)	Shortest Wingwall Pipe Runner Length (Ft-In)	Non-Sliding Pipe Length (Ft-In)	Pipe Runner Size (13)	Total Length of Wingwall Pipe Runners (Ft-In) (12)
24"	1	1	2' - 4 1/2"	1	3:1	24"	1' - 0"	2' - 0"	3	6' - 3"	2' - 7 1/2"	2	5' - 10 3/4"	5' - 11 1/2"	3	4' - 5 1/4"	2' - 3"	1' - 6 1/2"	3" STD	8' - 2 3/4"
	2	3	6' - 6 1/4"	3		27"	1' - 3"	2' - 0"	3	7' - 3"	2' - 7 1/2"	2	6' - 10"	6' - 9"	3	5' - 1 3/4"	2' - 7"	1' - 6 1/2"	3" STD	9' - 3 1/4"
	3	5	10' - 8"	5		30"	1' - 6"	3' - 0"	3	7' - 3"	4' - 0 1/2"	2	6' - 10"	7' - 6 1/2"	3	6' - 2 1/4"	3' - 7 3/4"	2' - 7 1/4"	3" STD	12' - 5 1/4"
	4	6	14' - 9 3/4"	6		33"	6"	2' - 6"	3	7' - 6"	3' - 4"	2	7' - 0 3/4"	8' - 4"	3	5' - 10"	3' - 2 1/2"	2' - 0 3/4"	3" STD	11' - 1 1/4"
	5	8	18' - 11 1/2"	8		36"	9"	2' - 0"	4	9' - 0"	2' - 7 1/2"	3	9' - 6 1/2"	9' - 1 1/2"	4	7' - 2"	2' - 5"	1' - 6 1/2"	4" STD	15' - 11"
	6	10	23' - 1 1/4"	10		42"	6"	2' - 3"	4	10' - 0"	2' - 11 3/4"	3	10' - 7 1/4"	10' - 8 1/4"	4	8' - 2 1/2"	2' - 11 1/4"	1' - 9 3/4"	4" STD	18' - 6 1/2"
27"	1	1	2' - 5 1/2"	1		48"	1' - 3"	2' - 9"	5	12' - 6"	3' - 8 1/4"	4	14' - 1 3/4"	13' - 0 3/4"	5	11' - 4 1/2"	3' - 5 3/4"	2' - 4"	4" STD	32' - 0 1/2"
	2	3	6' - 11 3/4"	3		54"	6"	2' - 0"	6	14' - 0"	2' - 7 1/2"	5	16' - 6"	14' - 7 3/4"	6	12' - 4"	2' - 6"	1' - 6 1/2"	4" STD	38' - 7 1/2"
	3	5	11' - 6"	5		60"	6"	2' - 6"	6	15' - 0"	3' - 4"	5	17' - 8"	16' - 2 3/4"	6	13' - 9"	3' - 2 1/2"	2' - 0 3/4"	4" STD	44' - 5 1/2"
	4	7	16' - 0 1/2"	7		66"	9"	2' - 0"	7	17' - 3"	2' - 7 1/2"	6	20' - 11"	17' - 9 3/4"	7	15' - 7 1/2"	2' - 7 3/4"	1' - 6 1/2"	4" STD	56' - 4 1/4"
	5	9	20' - 6 1/2"	9		72"	1' - 6"	2' - 0"	8	19' - 6"	2' - 7 1/2"	7	24' - 1 1/2"	19' - 4 3/4"	8	18' - 0 1/4"	2' - 7 1/4"	1' - 6 1/2"	5" STD	73' - 8 3/4"
	6	10	25' - 0 3/4"	10		24"	1' - 0"	2' - 0"	4	8' - 8"	2' - 7 1/2"	3	9' - 2 1/4"	8' - 3 3/4"	4	6' - 8 1/2"	2' - 2 3/4"	1' - 6"	3" STD	14' - 11"
30"	1	1	2' - 6 1/2"	1		27"	1' - 3"	2' - 0"	4	9' - 11"	2' - 7 1/2"	3	10' - 6 1/4"	9' - 3 3/4"	4	7' - 8"	2' - 6 3/4"	1' - 6"	4" STD	16' - 10 1/4"
	2	3	7' - 6 1/2"	3		30"	1' - 6"	2' - 0"	5	11' - 2"	2' - 7 1/2"	4	12' - 7 1/2"	10' - 4"	5	9' - 2 1/2"	2' - 3 1/2"	1' - 6"	4" STD	24' - 6"
	3	5	12' - 6 1/2"	5		33"	6"	2' - 0"	5	11' - 2"	2' - 7 1/2"	4	12' - 7 1/2"	11' - 4 1/2"	5	9' - 2 1/2"	2' - 3 1/2"	1' - 6"	4" STD	24' - 6"
	4	7	17' - 6 1/2"	7		36"	9"	2' - 0"	5	12' - 5"	2' - 7 1/2"	4	14' - 0 1/2"	12' - 4 3/4"	5	10' - 3"	2' - 6 3/4"	1' - 6"	4" STD	27' - 1 1/2"
	5	9	22' - 6 1/2"	9		42"	6"	2' - 0"	6	14' - 2"	2' - 7 1/2"	5	16' - 8 1/4"	14' - 5 1/2"	6	12' - 2"	2' - 5 1/4"	1' - 6"	4" STD	38' - 0 1/4"
	6	11	27' - 6 1/2"	11		48"	1' - 3"	2' - 6"	7	17' - 5"	3' - 4"	6	21' - 1 1/4"	17' - 6 3/4"	7	15' - 10 3/4"	3' - 1"	2' - 0 1/4"	4" STD	58' - 11 1/2"
33"	1	2	3' - 10 1/2"	2	54"	6"	2' - 0"	8	19' - 2"	2' - 7 1/2"	7	23' - 8 1/2"	19' - 7 1/2"	8	17' - 3 1/2"	2' - 5 3/4"	1' - 6"	5" STD	70' - 8 1/2"	
	2	4	9' - 3 1/4"	4	60"	6"	2' - 0"	9	21' - 2"	2' - 7 1/2"	8	26' - 7 1/4"	21' - 8 1/4"	9	19' - 4 3/4"	2' - 5"	1' - 6"	5" STD	88' - 9"	
	3	6	14' - 8"	6	66"	9"	3' - 0"	9	22' - 5"	4' - 0 1/2"	8	28' - 2"	23' - 9"	9	21' - 7"	3' - 7 1/4"	2' - 6 1/4"	5" STD	103' - 3 1/4"	
	4	9	20' - 0 3/4"	9	72"	1' - 6"	2' - 0"	11	26' - 2"	2' - 7 1/2"	10	33' - 7 3/4"	25' - 9 3/4"	11	24' - 6 1/4"	2' - 5 1/2"	1' - 6"	5" STD	136' - 4 3/4"	
	5	11	25' - 5 1/2"	11	24"	1' - 0"	3' - 0"	5	12' - 6"	4' - 0 1/2"	4	14' - 1 3/4"	13' - 0 1/4"	5	11' - 1 1/2"	3' - 6 1/4"	2' - 5 3/4"	4" STD	31' - 9 1/4"	
	6	13	30' - 10 1/4"	13	27"	1' - 3"	2' - 3"	6	15' - 0"	2' - 11 3/4"	5	17' - 8"	14' - 6 1/2"	6	12' - 10 3/4"	2' - 9"	1' - 8 1/2"	4" STD	40' - 10"	
36"	1	2	3' - 11 3/4"	2	30"	1' - 6"	2' - 0"	7	17' - 0"	2' - 7 1/2"	6	20' - 7 1/4"	16' - 0 3/4"	7	14' - 9"	2' - 5 1/2"	1' - 5 1/2"	4" STD	53' - 0 1/4"	
	2	4	9' - 10 1/4"	4	33"	6"	2' - 0"	7	17' - 6"	2' - 7 1/2"	6	21' - 2 1/2"	17' - 7"	7	15' - 2"	2' - 6"	1' - 5 1/2"	4" STD	54' - 5 1/2"	
	3	7	15' - 8 3/4"	7	36"	9"	2' - 0"	8	19' - 3"	2' - 7 1/2"	7	23' - 9 3/4"	19' - 1 1/4"	8	17' - 0 1/2"	2' - 4 3/4"	1' - 5 1/2"	5" STD	69' - 6"	
	4	9	21' - 7 1/4"	9	42"	6"	2' - 0"	9	22' - 0"	2' - 7 1/2"	8	27' - 7 3/4"	22' - 1 3/4"	9	19' - 9 1/2"	2' - 5 1/4"	1' - 5 1/2"	5" STD	90' - 4 1/2"	
	5	11	27' - 5 3/4"	11	48"	1' - 3"	2' - 0"	11	27' - 3"	2' - 7 1/2"	10	35' - 0 1/4"	26' - 8 1/2"	11	25' - 1"	2' - 5 3/4"	1' - 5 1/2"	5" STD	139' - 3 1/4"	
	6	14	33' - 4 1/4"	14	24"	1' - 0"	4' - 10 3/4"	2	4' - 9 3/4"	2	4' - 9 3/4"	2	4' - 9 3/4"	2	4' - 9 3/4"	2	4' - 9 3/4"	2	4' - 9 3/4"	2

- (11) If the outermost Wing Pipe Runner is a Non-Sliding Pipe Runner, the next outermost Wing Pipe Runner shall be considered the Shortest.
- (12) Quantities shown include, if present, the Non-Sliding Pipes.
- (13) Anchor Pipe size shall be the next smaller size than the Pipe Runner size.

**SPECIAL NOTE:**  
 Note that the tabular quantities are given for estimating purposes only. It is likely that these quantities will change due to field conditions. Therefore, all dimensions shall be verified by the Contractor in the field prior to fabrication of the Safety End Treatment components.


**STANDARD PIPE RUNNER AND ANCHOR PIPE SIZES (13)**

Pipe Size	Pipe O.D.	Pipe I.D.
2" STD	2.375"	2.067"
3" STD	3.500"	3.068"
4" STD	4.500"	4.026"
5" STD	5.563"	5.047"

**TOTAL PIPE LENGTHS FORMULAS:**

Total Length of All Pipe Runners = Total Length of Wingwall Pipe Runners + ( No. of Headwall Pipe Runners ) ( Headwall Pipe Runner Length )

Total Length of All Anchor Pipes = ( 3.000' ) ( No. of Wing Pipe Runners + No. of Headwall Pipe Runners - No. of Non-Sliding Pipe Runners )

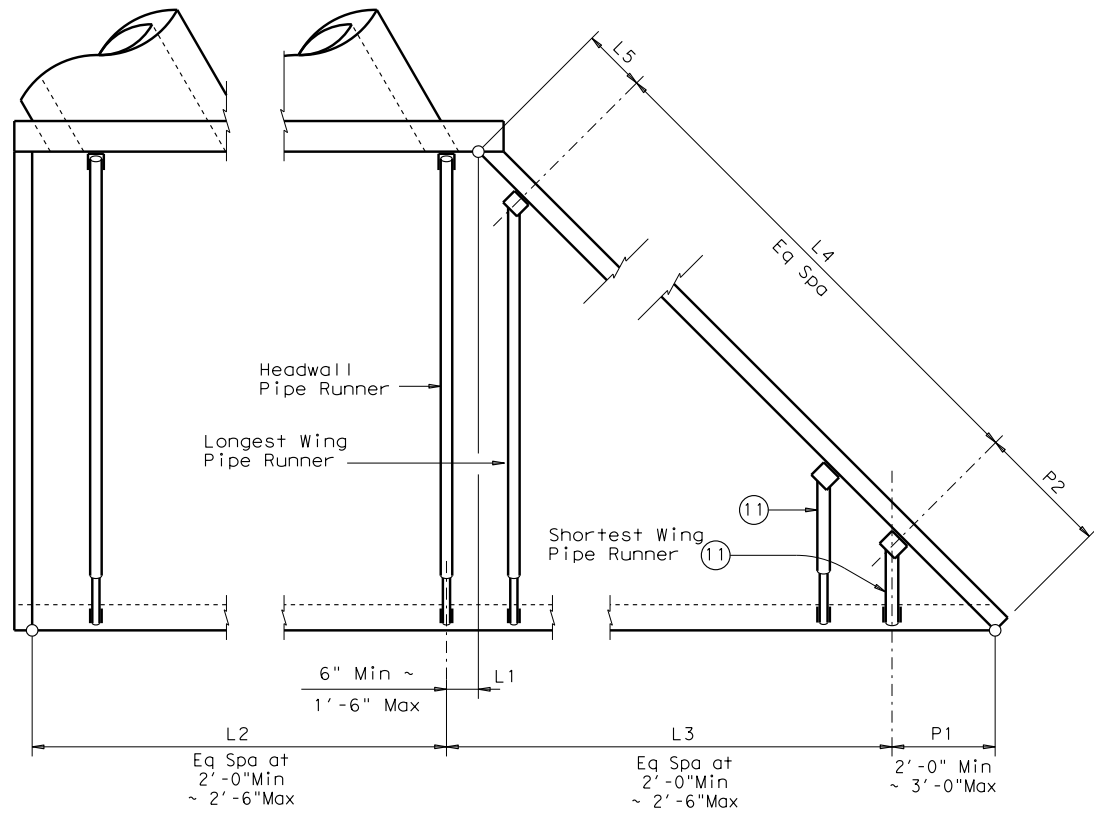

**PIPE RUNNER LAYOUT**  
 Note: Left forward culvert skew shown, actual culvert skew may be opposite hand.

**SAFETY END TREATMENT WITH FLARED WINGS**  
 FOR 30° SKEW PIPE CULVERTS TYPE I ~ CROSS DRAINAGE

**SETP-FW-30**

FILE: stpf30se.dgn	DN: GAF	CK: CAT	DW: TxDOT	CK: GAF
©TxDOT February 2010	CONT	SECT	JOB	HIGHWAY
REVISIONS	DIST		COUNTY	SHEET NO.